



Installation and mounting

Operation with 230 V devices

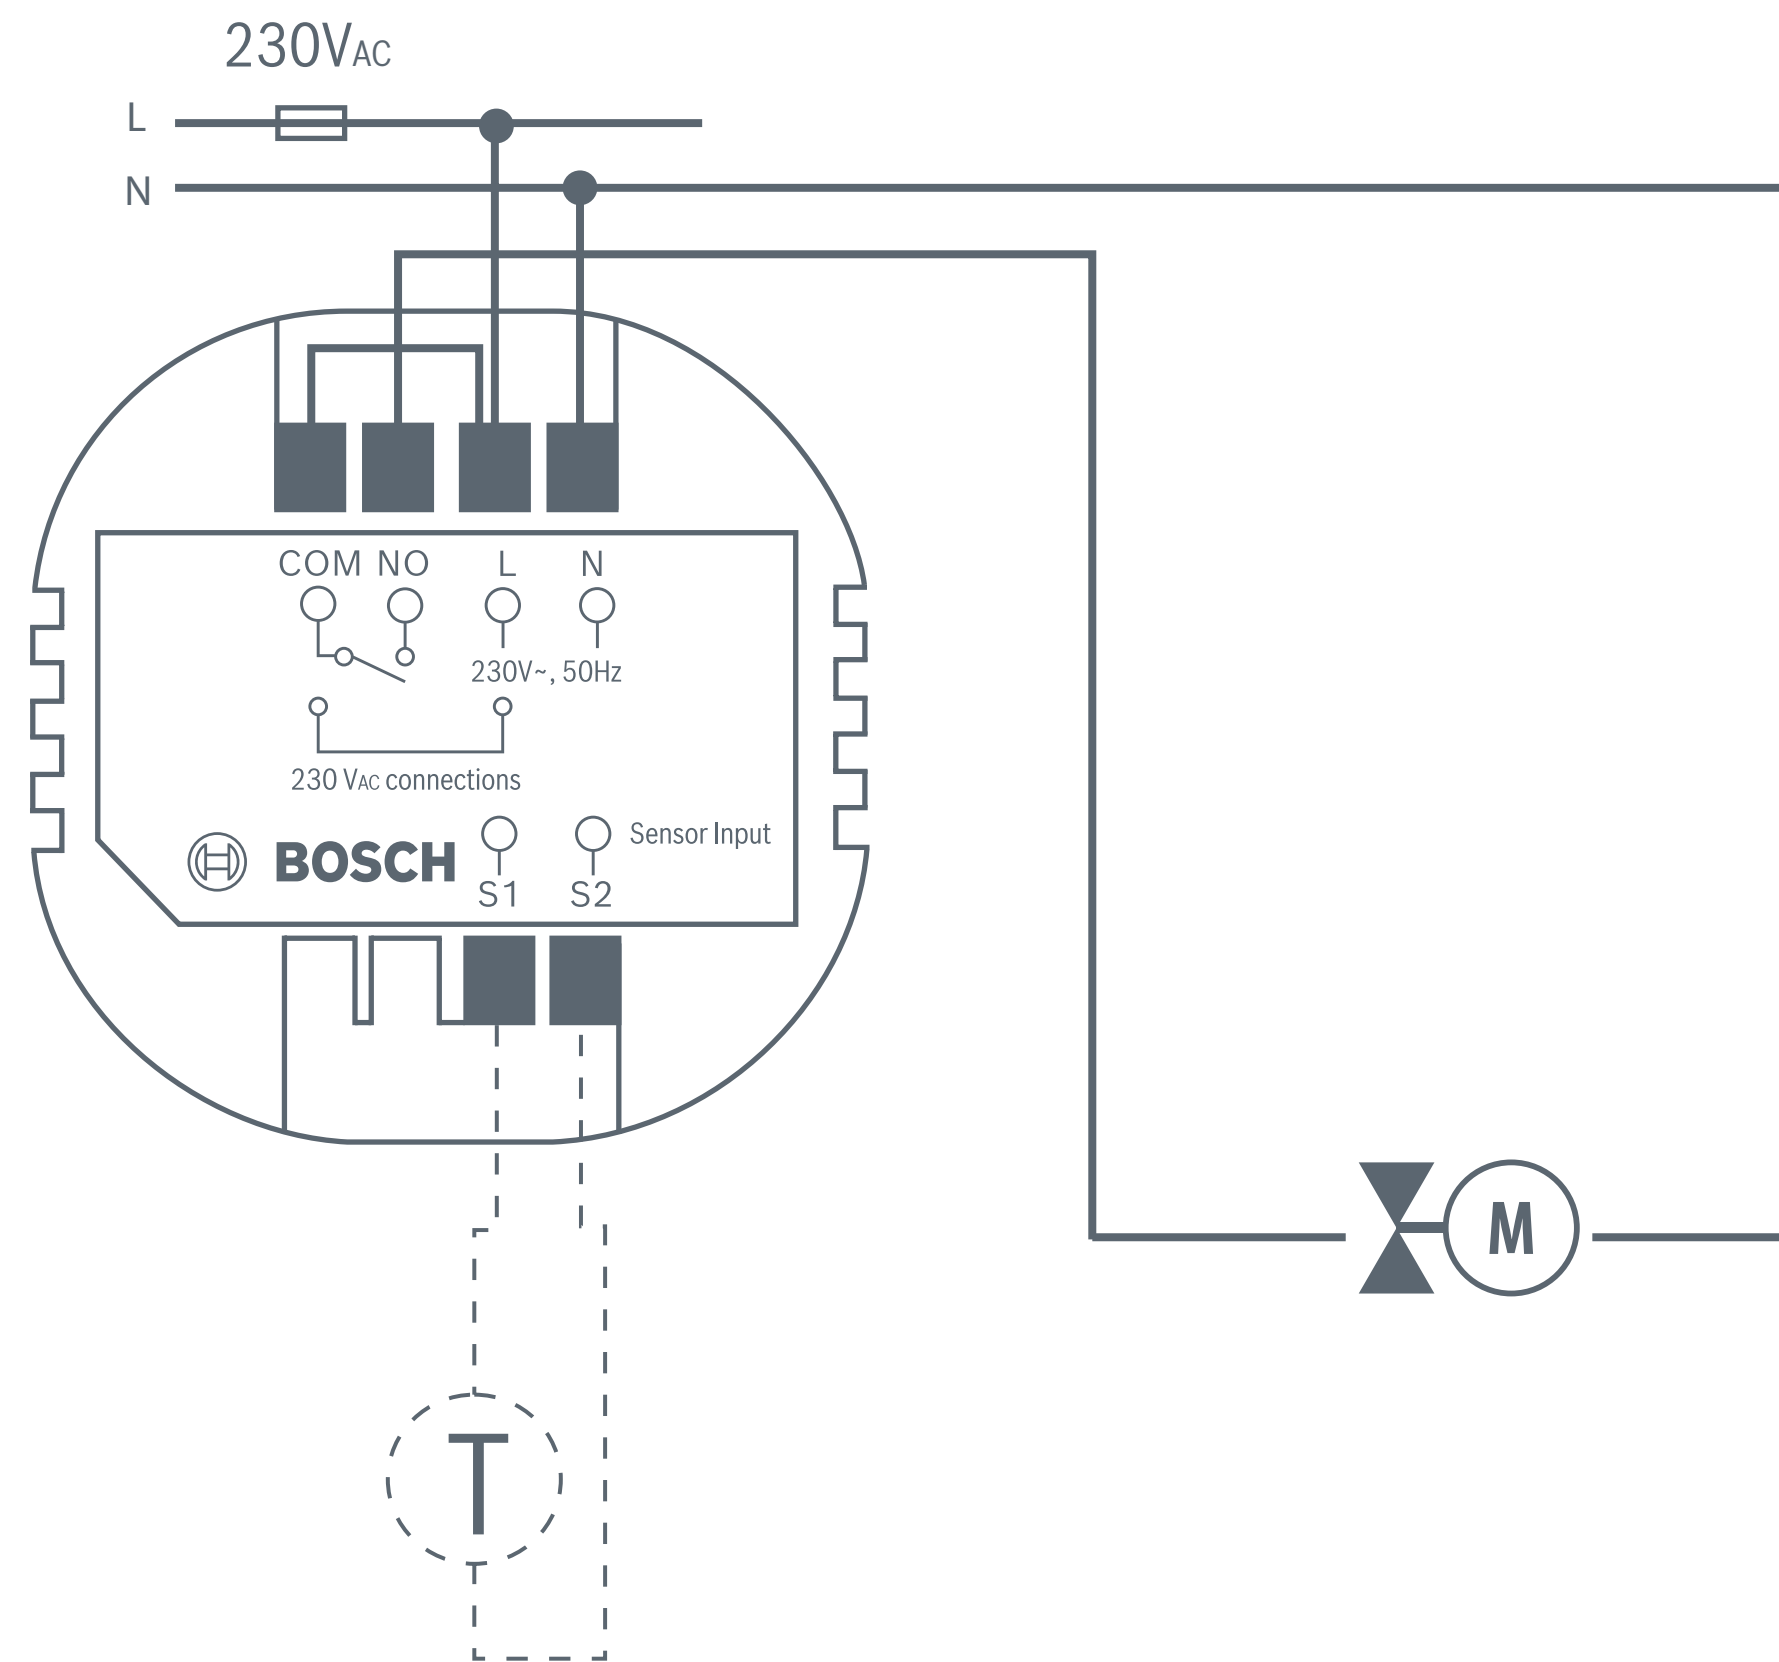

Connection	Description
L	External conductor (230V _{AC})
N	Neutral conductor
COM	Voltage-free input. For 230 V devices, connect the supply voltage to “L” via a wire bridge.
NO	Switching output for consumers.
S1/S2	Connections for external sensors or potential-free contacts.
T	External temperature sensor (available as optional accessory), e.g. installed in the floor.
	230 V actuator